



LESS THAN 1 AMP OF CURRENT IS NEEDED TO PROVIDE POWER TO TIMER AND DIMMERS. CAN BE PULLED FROM LOCAL POWER SOURCE OR DEDICATED CIRCUIT.

1 DIMMER CONTROLLING 2 RELAYS

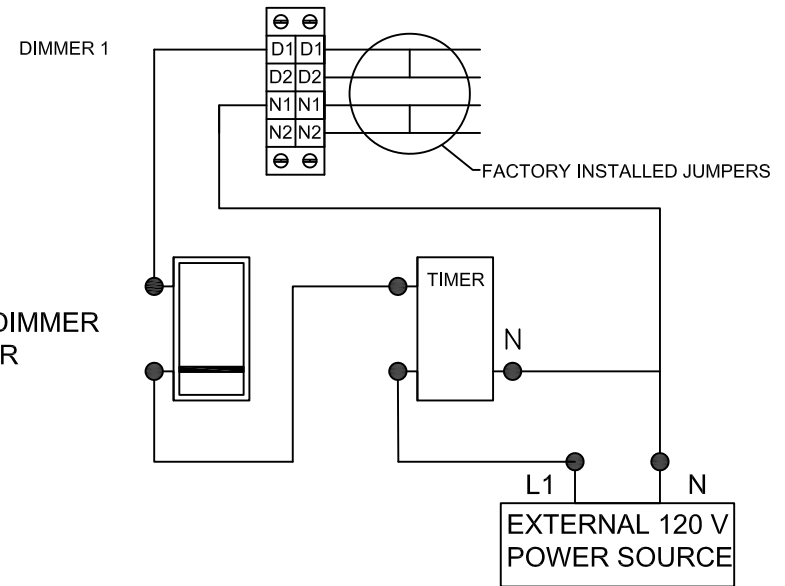

0-120VAC DIMMER WITH TIMER

1 DIMMER PER RELAY

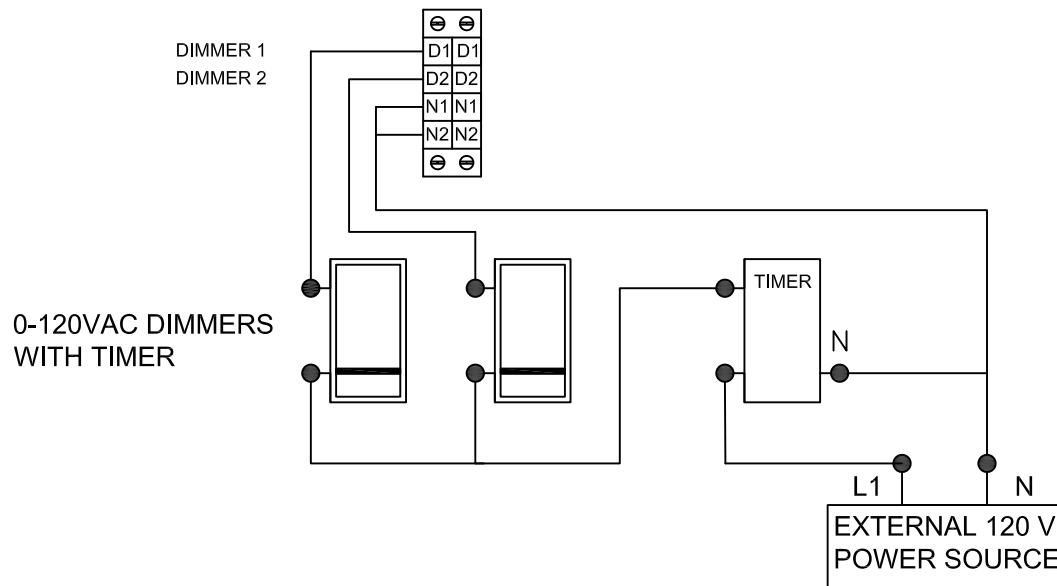

0-120VAC DIMMERS WITH TIMER

**INFRA**TECH™ 344 W 157th Street  
 Gardena, California 90248  
 Phone: (310) 354-1250  
 Fax: (310) 523-3674  
 www.infratech-usa.com

DESCRIPTION	
DIMMER AND TIMER WIRING EXAMPLES	
DATE	ITEM#
Dec. 16 2019	N/A
DRAWN BY:	
CL	

NOTE: ALL INFRA TECH PRODUCTS MUST BE INSTALLED BY A LICENSED ELECTRICIAN